

**NEPHI CITY POLICY
GAS SERVICE REQUIREMENTS**


Call Blue Stakes before digging.

It's the law.

1-800-662-4111

1. The gas meter is to be located within 10 feet of front (street side) of structure.
2. The customer is responsible to connect piping to the low-pressure side of the gas meter.
3. The gas meter is to be a minimum of 3 feet from windows that open, vents or openings.
4. The gas meter is to be a minimum of 3 feet measured horizontally from the electric service.
5. Utility must have free working space of 12 inches to the sides and 36 inches in front of meter.
6. If the gas meter is exposed to vehicle traffic, the meter must be protected by installing barrier posts (Contact Gas Department for specifications).
7. Dig trench 24 inches minimum 36 inches maximum from finished grade.
8. Backfill around gas pipe is to be screened sand. Sand is to envelop the gas pipe for 6 inches in all directions. Sand is to be provided by customer and must be on site and readily accessible to backhoe at time the gas service is installed.
9. A sleeve is required where the service riser passes dim pavement.
10. The gas line is not to be installed in the same trench with the power line.

If you have questions about any of these requirements, contact the Nephi City Gas Department @ 623-4914.

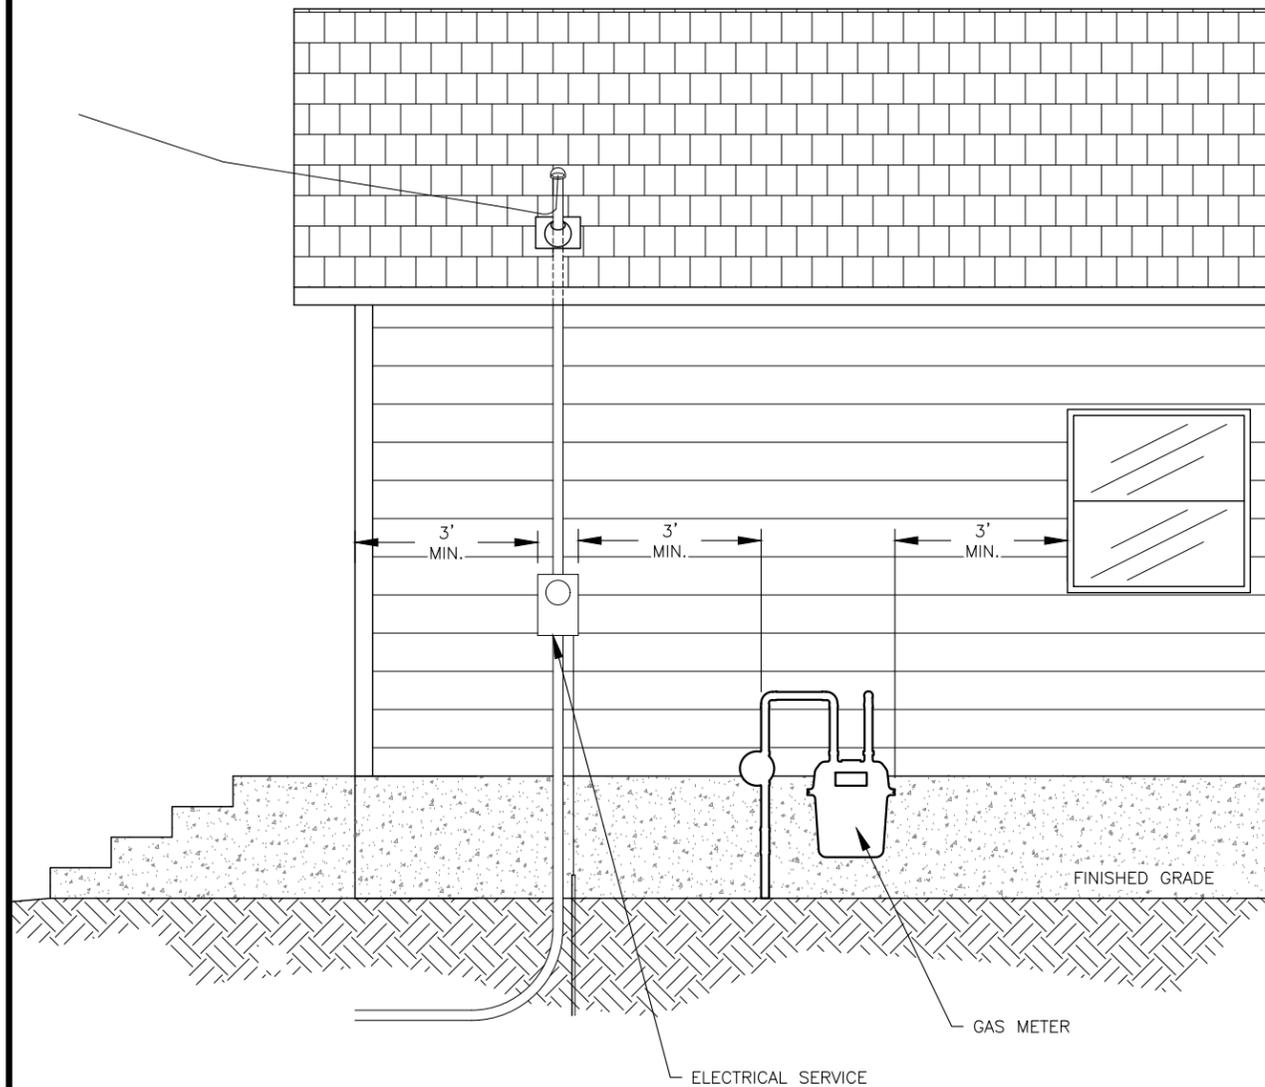

RESIDENTIAL SERVICE NOTES:

1. THE GAS METER IS TO BE LOCATED WITHIN 10 FEET OF FRONT (STREET SIDE) OF STRUCTURE.
2. THE CUSTOMER IS RESPONSIBLE TO CONNECT PIPING TO THE LOW-PRESSURE SIDE OF THE GAS METER.
3. THE GAS METER IS TO BE A MINIMUM OF 3 FEET FROM WINDOWS THAT OPEN, VENTS OR OPENINGS.
4. THE GAS METER IS TO BE A MINIMUM OF 3 FEET MEASURED HORIZONTALLY FROM THE ELECTRIC SERVICE.
5. UTILITY MUST HAVE FREE WORKING SPACE OF 12 INCHES TO THE SIDES AND 36 INCHES IN FRONT OF METER.
6. IF THE GAS METER IS EXPOSED TO VEHICLE TRAFFIC, THE METER MUST BE PROTECTED BY INSTALLING BARRIER POSTS (CONTACT GAS DEPARTMENT FOR SPECIFICATIONS).
7. DIG TRENCH 24 INCHES MINIMUM 36 INCHES MAXIMUM FROM FINISHED GRADE.
8. BACKFILL AROUND GAS PIPE IS TO BE SCREENED SAND. SAND IS TO ENVELOP THE GAS PIPE FOR 6 INCHES IN ALL DIRECTIONS. SAND IS TO BE PROVIDED BY CUSTOMER AND MUST BE ON SITE AND READILY ACCESSIBLE TO BACKHOE AT TIME THE GAS SERVICE IS INSTALLED.
9. A SLEEVE IS REQUIRED WHERE THE SERVICE RISER PASSES THROUGH PAVEMENT.
10. THE GAS LINE IS NOT TO BE INSTALLED IN THE SAME TRENCH WITH THE POWER LINE.

RESIDENTIAL NATURAL GAS SERVICE CONNECTION

SHEET

501


ORIGINAL
BY _____ DATE _____
REVISIONS
△ BY _____ DATE _____
△ BY _____ DATE _____
△ BY _____ DATE _____

**RESIDENTIAL &
COMMERCIAL
SERVICES CONNECTION DETAILS**

**STANDARD DRAWING
NEPHI CITY CORPORATION**

NEPHI CITY

21 EAST 100 NORTH
NEPHI, UTAH 84648

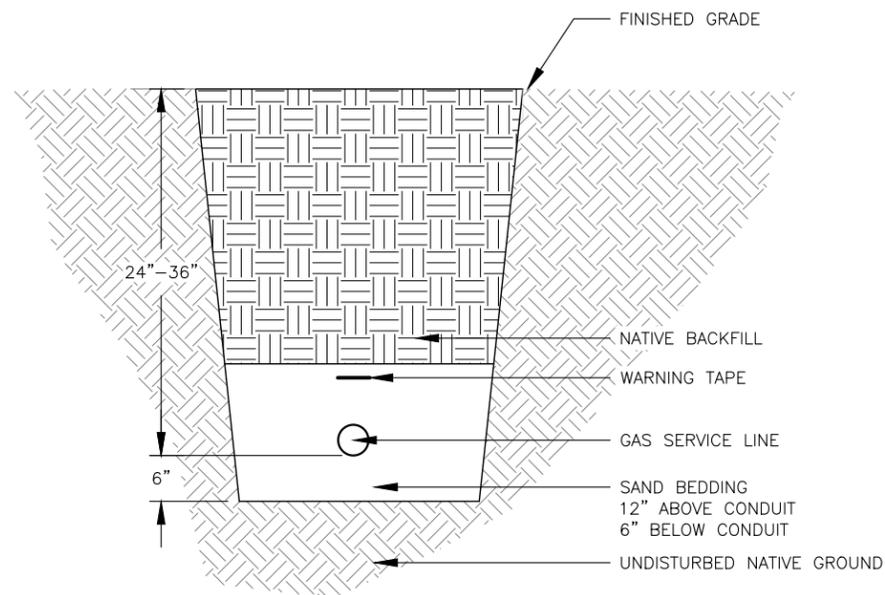

RESIDENTIAL SUBDIVISION SERVICE LINE TRENCH DETAIL

NOT TO SCALE

GENERAL NOTES:

1. THE GAS METER IS TO BE LOCATED WITHIN 10 FEET OF FRONT (STREET SIDE) OF STRUCTURE.
2. THE CUSTOMER IS RESPONSIBLE TO CONNECT PIPING TO THE LOW-PRESSURE SIDE OF THE GAS METER.
3. THE GAS METER IS TO BE A MINIMUM OF 3 FEET FROM WINDOWS THAT OPEN, VENTS OR OPENINGS.
4. THE GAS METER IS TO BE A MINIMUM OF 3 FEET MEASURED HORIZONTALLY FROM THE ELECTRIC SERVICE.
5. UTILITY MUST HAVE FREE WORKING SPACE OF 12 INCHES TO THE SIDES AND 36 INCHES IN FRONT OF METER.
6. IF THE GAS METER IS EXPOSED TO VEHICLE TRAFFIC, THE METER MUST BE PROTECTED BY INSTALLING BARRIER POSTS (CONTACT GAS DEPARTMENT FOR SPECIFICATIONS).
7. DIG TRENCH 24 INCHES MINIMUM 36 INCHES MAXIMUM FROM FINISHED GRADE.
8. BACKFILL AROUND GAS PIPE IS TO BE SCREENED SAND. SAND IS TO ENVELOP THE GAS PIPE FOR 6 INCHES IN ALL DIRECTIONS. SAND IS TO BE PROVIDED BY CUSTOMER AND MUST BE ON SITE AND READILY ACCESSIBLE TO BACKHOE AT TIME THE GAS SERVICE IS INSTALLED.
9. A SLEEVE IS REQUIRED WHERE THE SERVICE RISER PASSES THROUGH PAVEMENT.
10. THE GAS LINE IS NOT TO BE INSTALLED IN THE SAME TRENCH WITH THE POWER LINE.

SHEET

502

ORIGINAL

BY _____ DATE _____

REVISIONS

△ BY _____ DATE _____

△ BY _____ DATE _____

△ BY _____ DATE _____

**TRENCH DETAIL
&
GENERAL NOTES**

**STANDARD DRAWING
NEPHI CITY CORPORATION**

NEPHI CITY

21 EAST 100 NORTH
NEPHI, UTAH 84648